


### PLAN

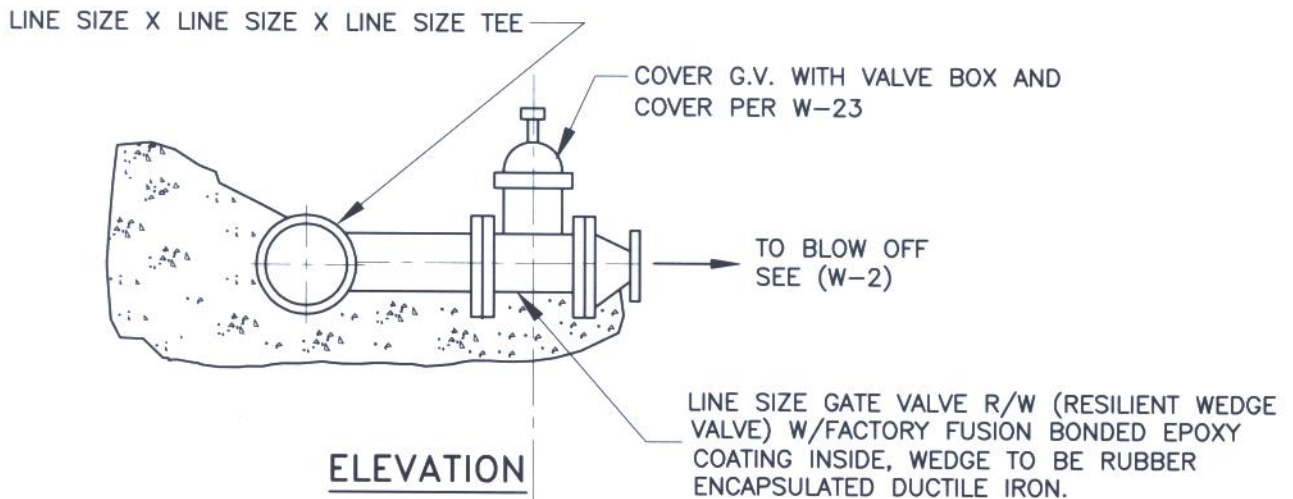

### ELEVATION

- ALL NUTS & BOLTS TO BE 316 STAINLESS STEEL.
- APPLY ANTI-SEIZE TO ALL S.S. BOLT THREADS.
- ALL VALVES AND FITTINGS TO BE WRAPPED WITH 2 LAYERS OF 8 MIL POLYETHYLENE.
- ALL FLANGES TO BE PRIMED AND WRAPPED WITH WAX-TAPE.

Revision	By	Approved	Date	CITY OF OCEANSIDE  GATED OUTLET ON WATER MAIN FOR FUTURE USE	 CITY ENGINEER <u>8/8/05</u> Date STANDARD DRAWING NO. <b>W-26</b>
11/06/00	kal				
06/14/01	DW				
09/18/02	DW				
07/19/04	AC				