


CONCRETE


THRUST BLOCK
W-27

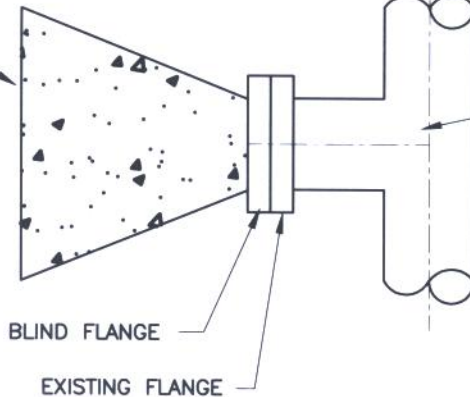

EXISTING
WATER LINE

FLANGED OUTLET


CONCRETE
THRUST BLOCK
PER W-27

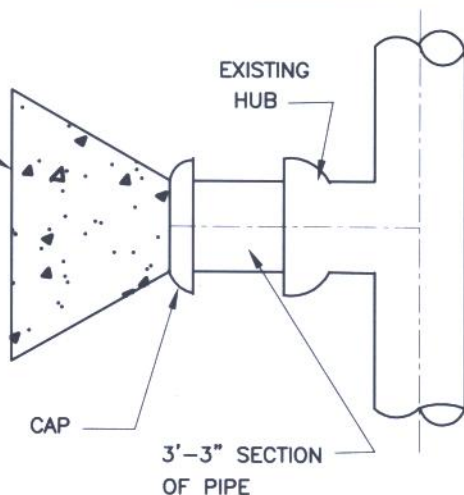

3'-3" SECTION
OF PIPE

HUB END

CONCRETE
THRUST BLOCK
PER W-27

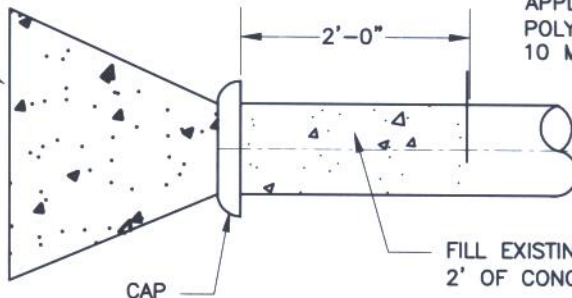

FILL EXISTING PIPE WITH
2' OF CONCRETE MINIMUM

END OF PIPE

NOTES

ALL 2" SERVICE CONNECTIONS AND LARGER MUST BE ABANDONED BY THE PROCEDURES SET BELOW.

1. IF THERE IS A 2" OR LARGER GATE VALVE THAN THE GATE VALVE MUST BE REMOVED AND THE SADDLE PLUGGED WITH A BRASS PLUG. THE SADDLE MUST BE INSPECTED FOR INTEGRITY BY A REPRESENTATIVE OF THE WATER UTILITIES DEPARTMENT.

2. IN THE CASE OF A CORPORATION STOP THE CORPORATION IS TO BE PLUGGED WITH A BRASS PLUG. THIS MUST BE INSPECTED BY A REPRESENTATIVE OF THE WATER UTILITIES DEPARTMENT.

3. IN THE CASE OF A BRANCH LINE ABOVE 2", THE VALVE IS TO BE REMOVED AND A BLIND FLANGE INSTALLED. THIS MUST BE INSPECTED BY A REPRESENTATIVE OF THE WATER UTILITIES DEPARTMENT.

4. WRAP SERVICE SADDLE (IF APPLICABLE) WITH 2 LAYERS OF 8 MIL POLYETHYLENE (P.E.) AND SECURE WITH 10 MIL P.E. TAPE.

Revision	By	Approved	Date
11/07/00	kal		
06/14/01	DW		
09/16/04	AC		

CITY OF OCEANSIDE

WATER LINE
ABANDONMENT

CITY ENGINEER'S Date

STANDARD
DRAWING NO. W-28