


**ELEVATION VIEW**

**NOTES:**

1. PUBLIC WATER MAIN.
2. 90°, DUCTILE IRON ELBOW: FLG X FLG; FLG X PO; (UNI-FLANGE SHALL NOT BE USED).
3. FLANGED DUCTILE IRON SPOOL (BOTH ENDS SHALL BE FLANGED).
4. 90°, FLANGED DUCTILE IRON ELBOW.
5. FACTORY ASSEMBLED WITH A BY-PASS METER.

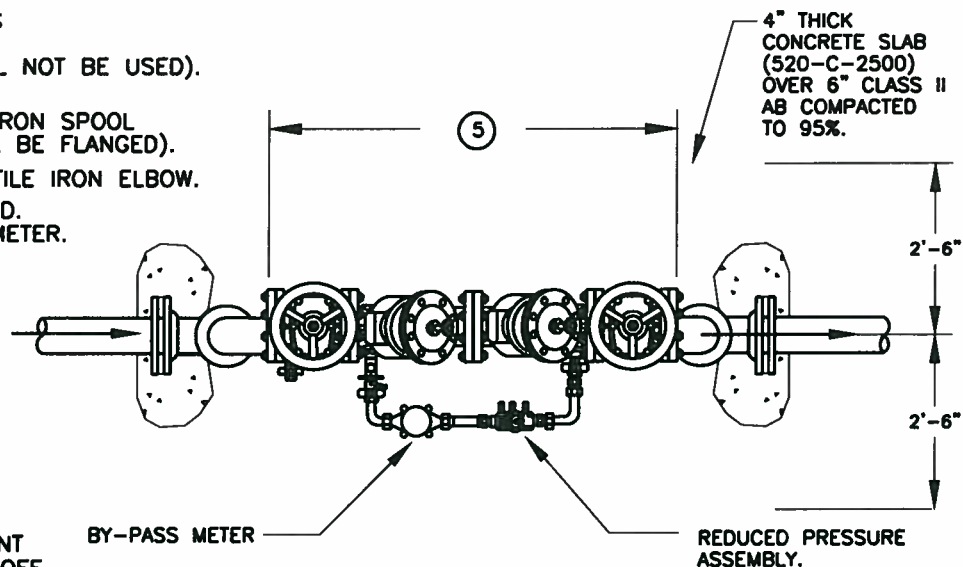

**PLAN VIEW**

REDUCED PRESSURE DETECTOR CHECK ASSEMBLY W/RESILIENT SEATED OS&Y SHUT OFF VALVES APPROVED BY THE DEPT. OF HEALTH SERVICES, OFFICE OF DRINKING WATER,

THIS ASSEMBLY SHALL BE INSPECTED BY THE WATER UTILITIES DEPARTMENT. AFTER WATER UTILITIES DEPARTMENT'S APPROVAL ASSEMBLY SHALL BE TESTED BY A TESTER ON THE CITY'S APPROVED TESTER LIST. THE DEVELOPER/OWNER IS RESPONSIBLE FOR THE COST OF TESTING THE ASSEMBLY. THERE AFTER, THE ASSEMBLY SHALL BE TESTED ANNUALLY AT THE OWNER'S EXPENSE. THE TEST REPORT IS TO BE SUBMITTED TO THE CITY WATER UTILITIES DEPARTMENT. PHONE NUMBER 760-435-5864

Revision	By	Approved	Date	CITY OF OCEANSIDE	
08-28-09	DW	SUD	8-28-09		
				REDUCED PRESSURE - DETECTOR CHECK ASSEMBLY	
				CITY ENGINEER	Date
				STANDARD DRAWING NO. W-29	