



PLAN

STANDARD WYE OR
"CUT-IN" WYE CONNECTION.
WHERE A CUT-IN WYE IS
USED, IT SHALL BE
SURROUNDED WITH A
MINIMUM OF 6" OF CLASS
470-C-2000 CONCRETE.

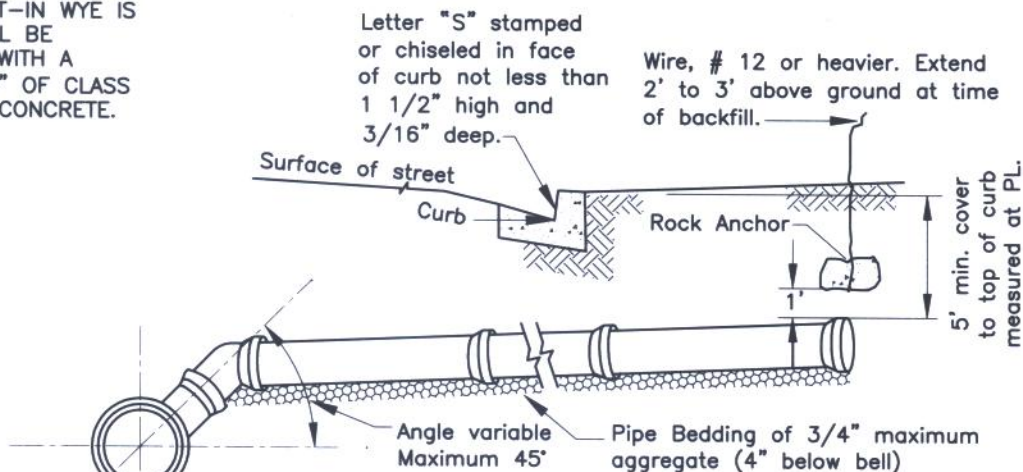

ELEVATION

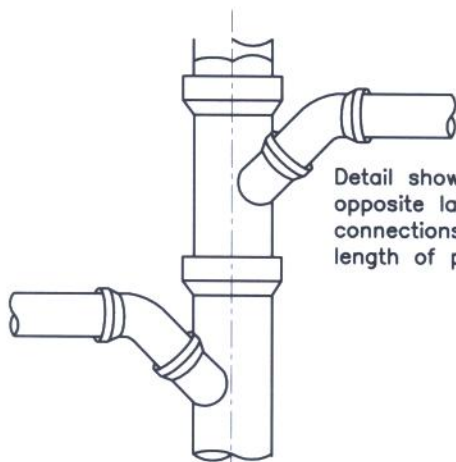

DETAIL

Detail showing the manner of connecting
opposite laterals to a sewer main. Two
connections shall not be made in the same
length of pipe.

NOTES

1. In no case shall a lateral connect to the sewer main directly on top of the pipe.
2. Sewer laterals shall have a minimum slope of 2%.
3. Sewer lateral pipe shall be of the same material as the main.
4. Lateral shall extend to property line unless otherwise shown on plans.
5. Place minimum 3" wide detector tape marked "SEWER" 1' above pipe along entire lateral.

Revision	By	Approved	Date
04/16/01	kal		
09/27/02	DW		
08/06/04	AC		

CITY OF OCEANSIDE

**HOUSE CONNECTION
(SEWER LATERAL)**

M. Torgie
CITY ENGINEER 8/8/05 Date

STANDARD
DRAWING NO. **S-3**