

BRASS HOSE ADAPTER AND 4" X 2 1/2" BRASS  
FIRE NOZZLE WITH CAP AND CHAIN


WARNING TAG  
CHRISTY'S MODEL  
ID-MAX-P2-RCIP2

24" X 36" PRECAST  
CONCRETE VAULT  
WITH CAST IRON  
COVER

4" DIA. SCH. 40  
GALV. STEEL PIPE  
THREADED ON BOTH  
ENDS

\* SIDEWALK

FUTURE CURB

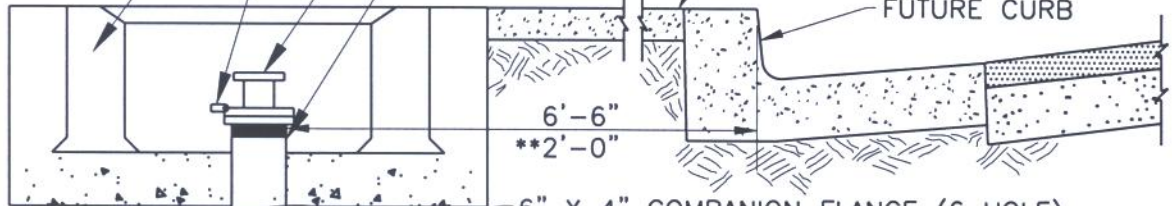

FLANGED  
FITTING

6" 90°  
PUSH ON  
x FL  
BEND (NO  
MJs ARE  
ALLOWED)

6" P.V.C. OR D.I.P.

6" X 4" COMPANION FLANGE (6 HOLE)

ENCASE ALL FERROUS METALS  
IN 6" OF NATURAL RIVER SAND

BLOW-OFF STRUCTURE TO HAVE GATE  
VALVE SAME AS BLOW-OFF STANDARD  
DWG NO. W-2

THRUST BLOCK PER RW-20 POURED AGAINST  
UNDISTURBED EARTH

\* NOTE: ON TEMPORARY DEAD END STREETS THE BLOW-OFF  
SHALL BE PLACED BEHIND THE BARRICADE  
PAINT WITH OSHA 300 PURPLE PAINT.

\*\* WHEN BLOW-OFF IS LOCATED IN PARKWAY

1. COVER SHALL BE PRINTED WITH "CITY OF OCEANSIDE  
RECLAIMED WATER" PER SECTION 4 OF THE MANUAL.

Revision	By	Approved	Date
07/26/99	kal		
08/06/04	AC		

CITY OF OCEANSIDE

STANDARD 4" BLOW-OFF

CITY ENGINEER *h. tonye* Date

STANDARD  
DRAWING NO. RW-2