



APPROVED FIRE HYDRANT MODELS			
TYPE	OUTLETS	JAMES JONES	AVK
SINGLE FAMILY	1-2 1/2", 1-4"	MODEL J - 4040	AVK - 2470
MULTI FAMILY	2-2 1/2", 1-4"	MODEL J - 4060	AVK - 2490
COMMERCIAL	2-2 1/2", 1-4"	MODEL J - 4060	AVK - 2490
INDUSTRIAL	2-2 1/2", 1-4"	MODEL J - 4060	AVK - 2490

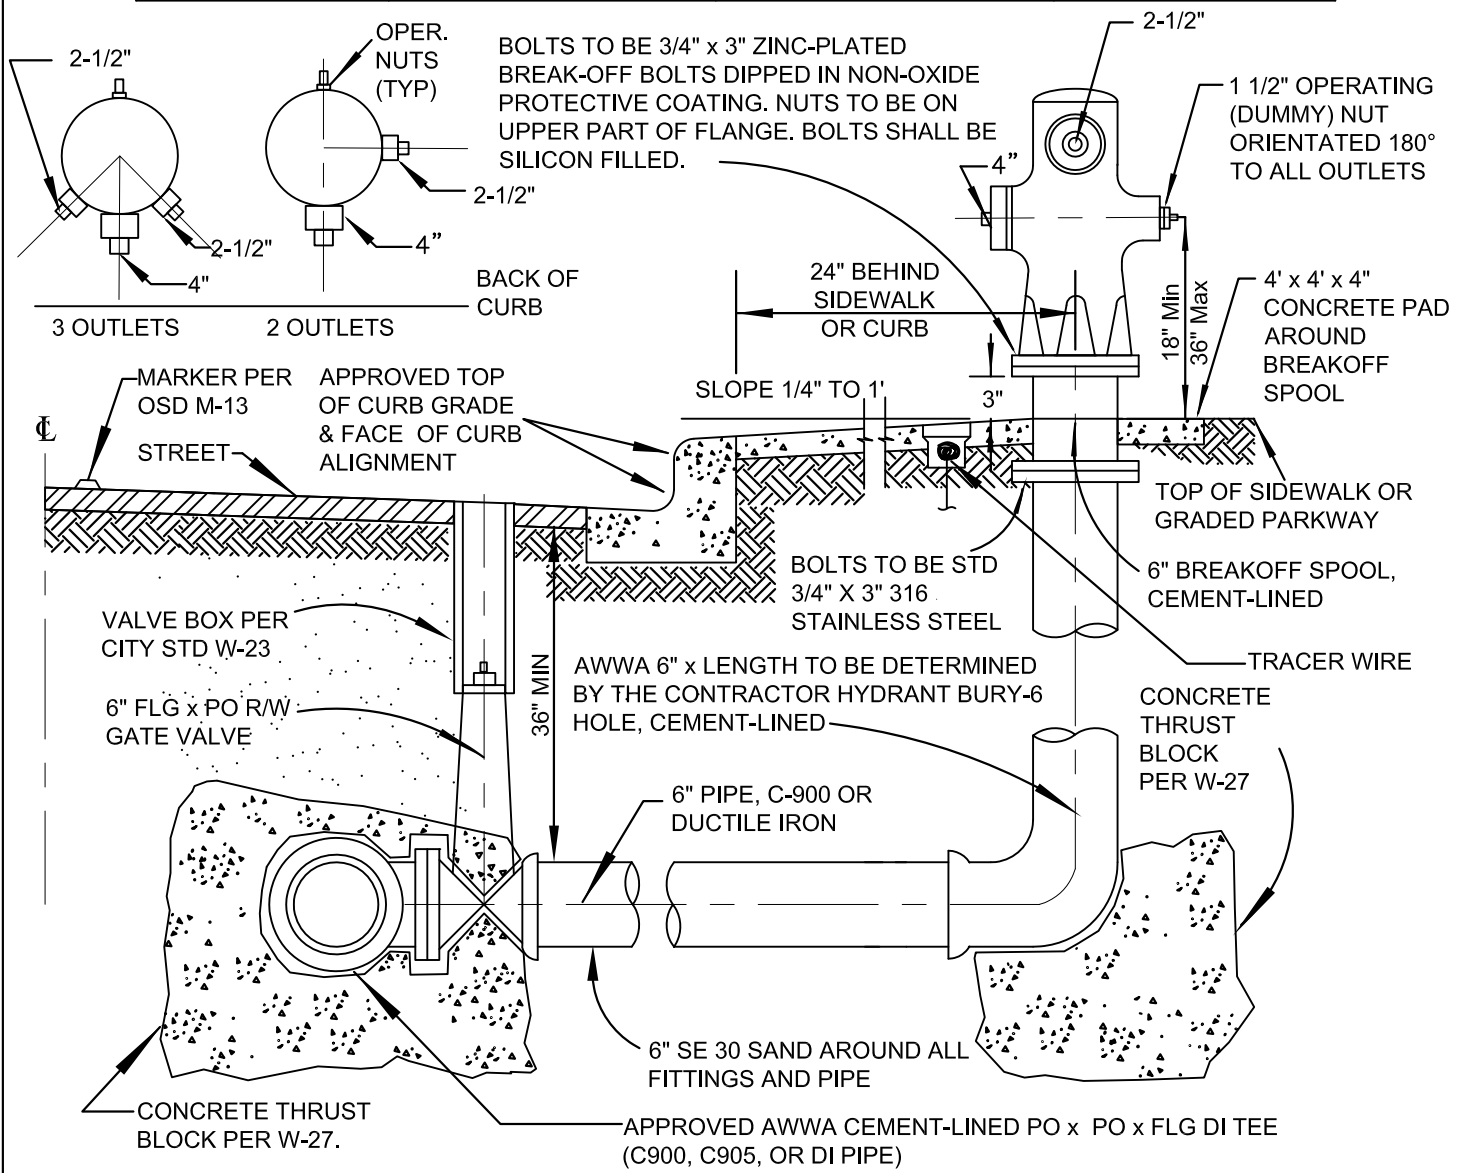

**NOTES:**

1. FINISH WITH APPROVED FIRE HYDRANT MARINE ENAMEL YELLOW 1000-20 PAINT, MANUFACTURED BY PRO-LINE.
2. ALL PRIVATE HYDRANTS SHALL BE FINISHED WITH MARINE ENAMEL OSHA SAFETY RED 1000-29, MANUFACTURED BY PRO-LINE.
3. ALL BURIED NUTS AND BOLTS TO BE STAINLESS STEEL.
4. PLACE DETECTOR TAPE MARKED "WATER" 1 FOOT ABOVE PIPE ALONG ENTIRE RUN.
5. ALL DUCTILE IRON PIPE AND FITTINGS SHALL BE ENCASED WITH 2 LAYERS OF 8 MIL POLYETHYLENE.
6. CHECK VALVE TYPE FIRE HYDRANTS SHALL BE REQUIRED AT DISCRETION OF WATER UTILITIES DEPT.
7. PLACE TRACER WIRE AT EVERY 600' OR EVERY OTHER FIRE HYDRANT. BOX SHALL BE COPPERHEAD SNAKEPIT TRACER BOX (CD14BLUTP).



LEGEND ON PLANS

Revision	By	Approved	Date
03/15/05	AC		
06/04/07	AC		
12/01/11	DW		
04/10/12	DW		
04/25/17	MU		
07/01/17	SM		08/01/17

**CITY OF OCEANSIDE**

**FIRE HYDRANT**

*Steven E. Strapan* 9/17/17

CITY ENGINEER Date

STANDARD DRAWING NO. **W-1**