

NOTES :

1. WATER METER BOX TO BE REMOVED:
 - A. PARKWAY - FILL & COMPACT HOLE WITH CLEAN DIRT AND GRADE LEVEL.
 - B. SIDEWALK - REMOVE AND REPLACE CONCRETE INCLUDING CURB AND GUTTER FROM SCORE TO SCORE.
2. CONTACT WATER UTILITIES DEPARTMENT TO COORDINATE WATER MAIN SHUTDOWN FOR 1 1/2" OR 2" BALL VALVE REMOVAL.
3. ABANDONMENT OF SERVICE MUST BE INSPECTED BY REPRESENTATIVE OF THE WATER UTILITIES DEPARTMENT FOR INTEGRITY.
4. CITY FORCES TO REMOVE EXISTING WATER METER.
5. PLUG ENDS OF ABANDONED COPPER SERVICE. ABANDON-IN PLACE, UNLESS NOTED OTHERWISE.


Revision	By	Approved	Date
11/07/00	kal		
06/14/01	DW		
09/16/02	DW		
06/04/07	AC		
03/21/17	MU		

CITY OF OCEANSIDE

**1 1/2" OR 2" WATER METER SERVICE
ABANDONMENT**


Steven E. Strapac 9/17/17
CITY ENGINEER Date

STANDARD DRAWING NO. **W-6b**

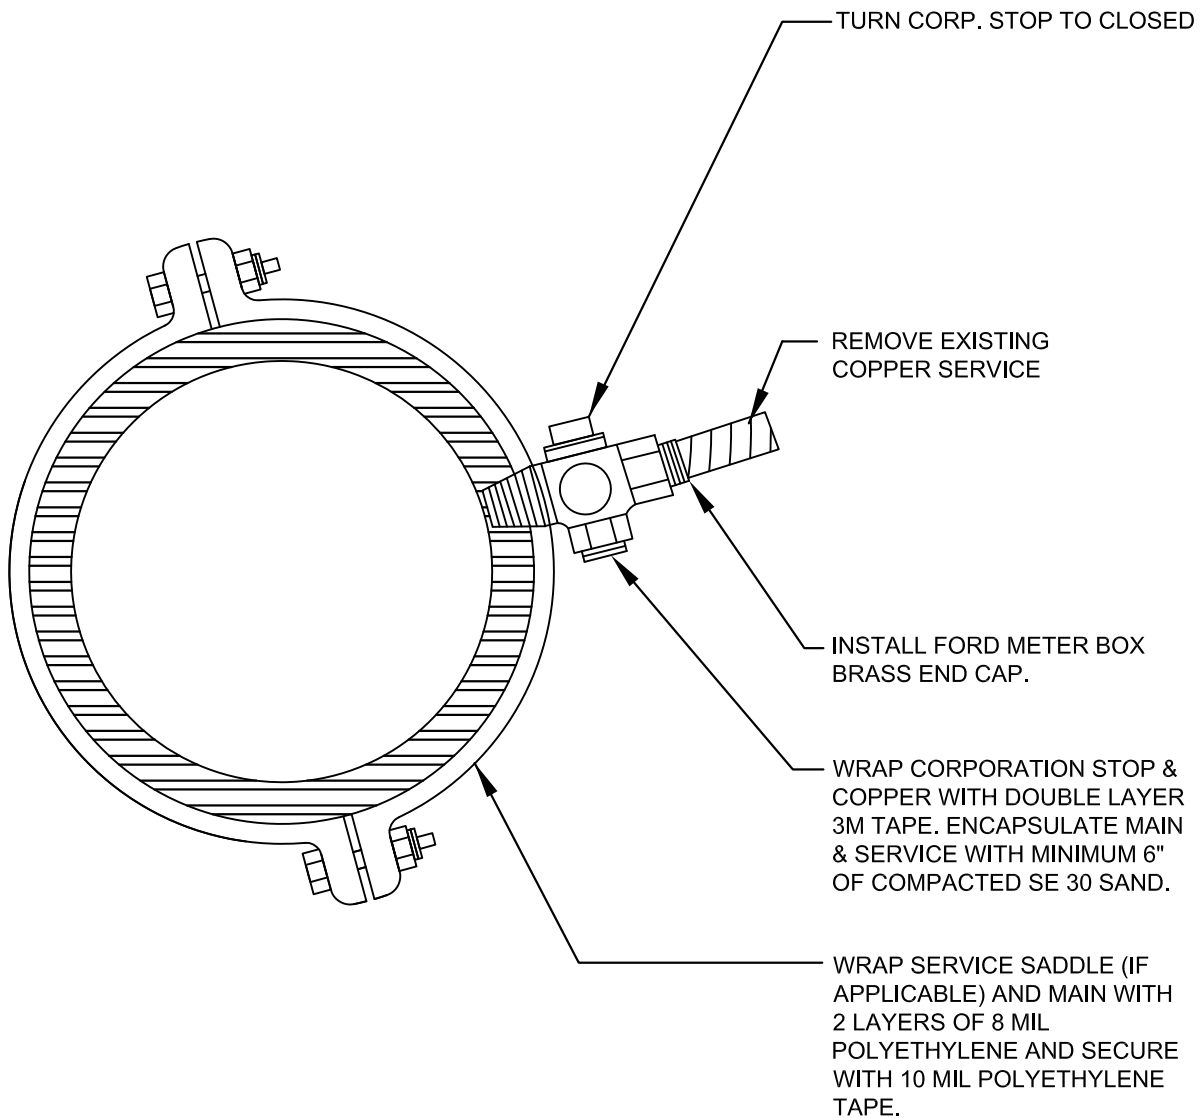

NOTES :

1. WATER METER BOX TO BE REMOVED:
 - A. PARKWAY - FILL & COMPACT HOLE WITH CLEAN DIRT AND GRADE LEVEL.
 - B. SIDEWALK - REMOVE AND REPLACE CONCRETE INCLUDING CURB AND GUTTER FROM SCORE TO SCORE.
2. PLUG FOR CORPORATION STOP MUST BE INSPECTED BY REPRESENTATIVE OF THE WATER UTILITIES DEPARTMENT FOR INTEGRITY.
3. CITY FORCES TO REMOVE EXISTING WATER METER.
4. PLUG ENDS OF ABANDONED COPPER SERVICE, ABANDON-IN PLACE, UNLESS NOTED OTHERWISE.
5. FORD METER BOX BRASS END CAP. 1" MODEL CAP-2-4-NL. 3/4" MODEL CAP-24-3-NL

Revision	By	Approved	Date	<p style="text-align: center;">CITY OF OCEANSIDE</p>			
06/14/01	DW					<p>3/4" OR 1" WATER METER SERVICE ABANDONMENT</p>	
09/16/02	DW			 9/17/17 CITY ENGINEER Date			
06/04/07	AC			STANDARD DRAWING NO. W-6a			
01/04/16	MU						
07/01/17	SM		08/01/17				