


ELEVATION VIEW

NOTES:

1. PRIVATE RECLAIMED WATER MAIN.
2. 90°, DUCTILE IRON ELBOW: FLG X FLG; FLG X P.O.; (UNI-FLANGE SHALL NOT BE USED).
3. FLANGED DUCTILE IRON SPOOL. (BOTH ENDS SHALL BE FLANGED).
4. 90° FLANGED DUCTILE IRON ELBOW.
5. FACTORY ASSEMBLED.
6. PAINT ALL ABOVE GROUND PIPING AND APPURTENANCES SAFETY PURPLE

* ASSEMBLY TO BE APPROVED BY THE DEPARTMENT OF HEALTH SERVICES, OFFICE OF DRINKING WATER AND CITY OF OCEANSIDE WATER UTILITIES DEPARTMENT. ASSEMBLY SHALL BE INSTALLED DOWNSTREAM OF THE METER WITHIN 18". NO CONNECTION BETWEEN THE METER AND THE ASSEMBLY IS PERMITTED.

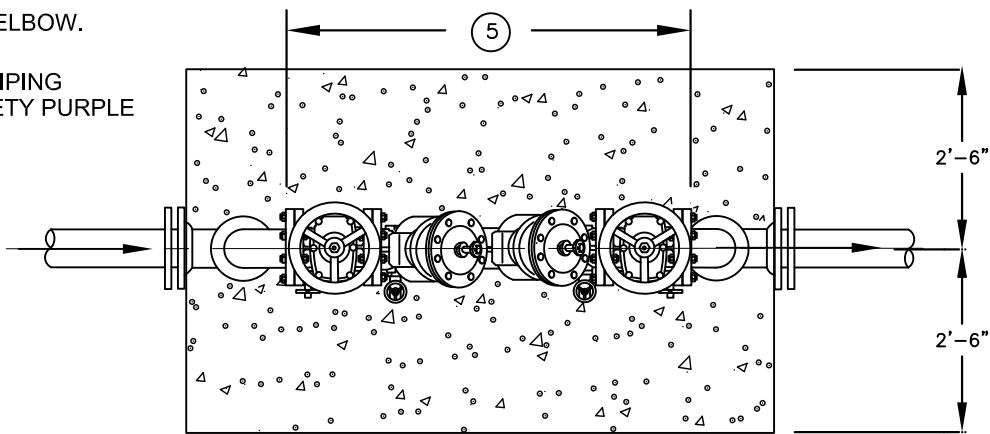


PLAN VIEW

THIS ASSEMBLY SHALL BE INSPECTED BY THE WATER UTILITIES DEPARTMENT. AFTER WATER UTILITIES DEPARTMENT'S APPROVAL ASSEMBLY SHALL BE TESTED BY A CITY APPROVED TESTER. THE DEVELOPER/OWNER IS RESPONSIBLE FOR THE COST OF TESTING THE ASSEMBLY. THERE AFTER, THE ASSEMBLY SHALL BE TESTED ANNUALLY THE TEST REPORT IS TO BE SUBMITTED TO THE CITY WATER UTILITIES DEPARTMENT. PHONE # 760-435-5864

Revision	By	Approved	Date
04/05/01	kal		
08/30/04	AC		
09/29/15	IN		
07/01/17	SM		08/01/17

CITY OF OCEANSIDE

REDUCED PRESSURE PRINCIPLE ASSEMBLY (3" & LARGER)

 9/17/17
 CITY ENGINEER Date
 STANDARD DRAWING NO. **RW-8**