


NOTES

- ALL NUTS & BOLTS TO BE 316 STAINLESS STEEL.
- APPLY ANTI-SEIZE TO ALL SS BOLT THREADS
- ALL VALVES AND FITTINGS TO BE WRAPPED WITH 2 LAYERS OF 8 MIL POLYETHYLENE.
- ALL FLANGES TO BE PRIMED AND WRAPPED WITH WAX-TAPE.
- MARK ALL PIPE WITH RECYCLED WATER MARKING TAPE

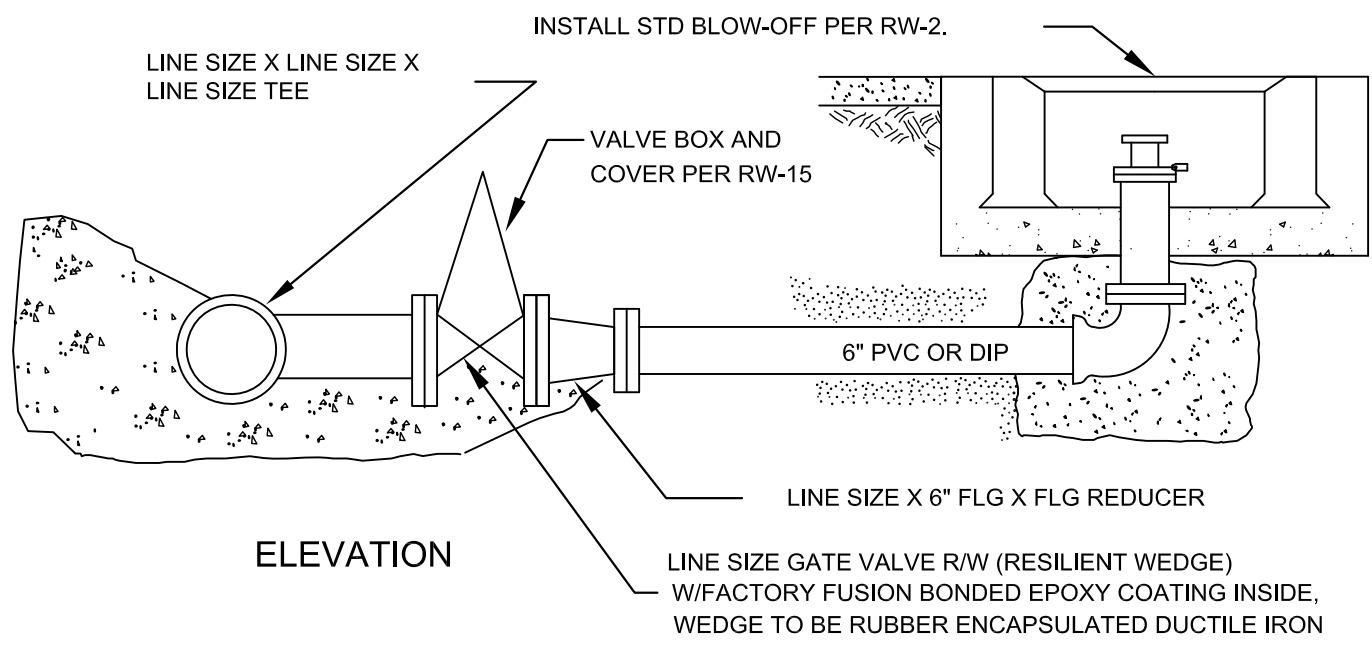

Revision	By	Approved	Date
11/06/00	kal		
08/05/04	AC		
09/30/15	IN		
07/01/17	SM		08/01/17

CITY OF OCEANSIDE

GATED OUTLET ON RECYCLED WATER

MAIN FOR FUTURE USE

Steven E. Strapac 9/17/17
 CITY ENGINEER Date

STANDARD DRAWING NO. **RW-19**