
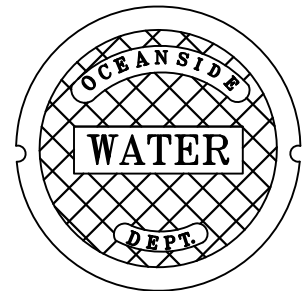


**TYPICAL CROSS SECTION**

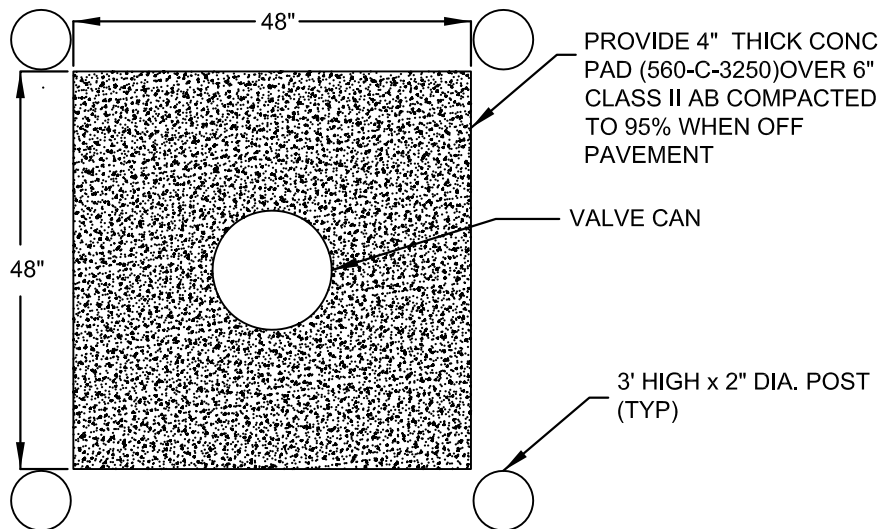

**PLAN**

**NOTES:**

1. ON STREETS WITH A SPEED LIMIT OVER 35 MPH USE SBF 1208N
2. WHERE DEPTH TO OPERATOR NUT EXCEEDS 9' PROVIDE VALVE STEM EXTENSION PER W-24
3. COVER WITH CITY OF OCEANSIDE WATER DEPARTMENT CASTED ON TOP BY SOUTH BAY FOUNDRY FRAME AND COVER SBF 1208 FOR SPEEDS 35 MPH OR LESS.
4. COVER FOR PRIVATE WATER VALVES SHALL BE LABELED " PRIVATE WATER " CASTED ON TOP.

Revision	By	Approved	Date	<b>CITY OF OCEANSIDE</b>	<i>Steven E. Strapan</i> 9/17/17 CITY ENGINEER      Date
10/22/02	DW				
06/04/07	AC				
03/05/08	DW				
09/22/10	DW				
05/01/17	MU				
07/01/17	SM		08/01/17		